
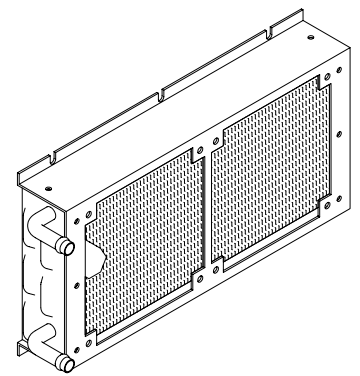
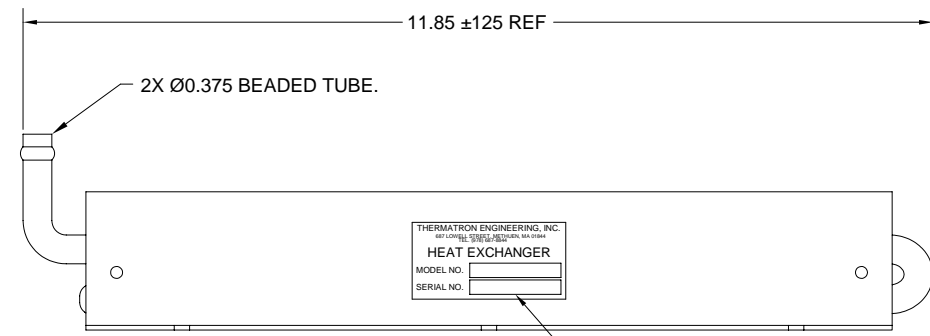
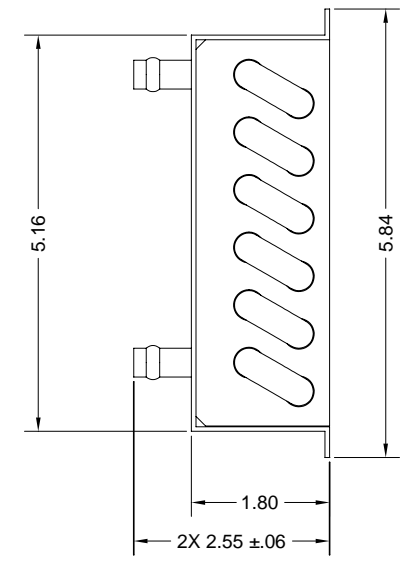
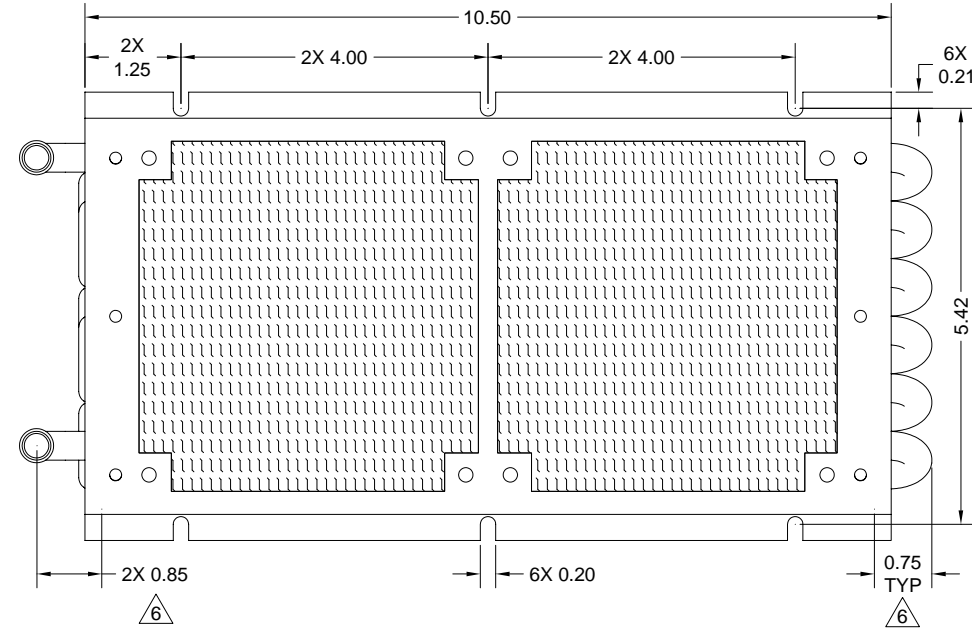


REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	RELEASED	11/02/2000	D. SAVOY

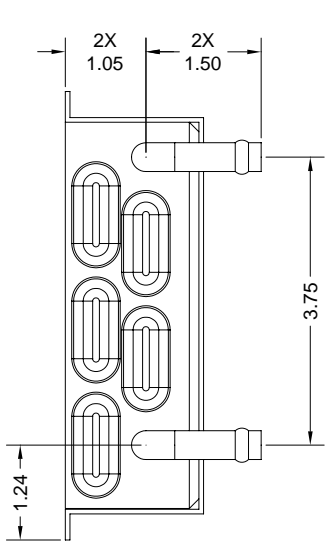

- NOTES:
1. WELD PER A8381.
 2. PRESSURE TEST 150 PSI N2 UNDER WATER.
 3. BRIGHTEN FINN PRIOR TO FRAME ASS'Y PER. TEP 101-06.
 4. INTERNAL FLUSH AND TUBE TREAT PER TEP 101-07.
 5. FRAME FINISH GOLD IRRIDITE PER. MIL-C-5441.
 6. DIMENSION FROM TUBE SHEET.

APPLY LABEL WHERE SHOWN,
MARK WITH DATE CODE AND
MODEL NUMBER

THERMATRON ENGINEERING, INC.
687 LOWELL STREET, METHUEN, MA 01544
HEAT EXCHANGER
MODEL NO. _____
SERIAL NO. _____

CONFIDENTIAL INFORMATION	DRAWN BY: S. RABBITT	DATE: 11/02/2000	THERMATRON ENGINEERING Inc.		
	CHECKED BY: D. SAVOY	DATE: 11/02/2000	687 LOWELL STREET, METHUEN, MA 01544 * PHONE: (978)-687-8844 FAX: (978)-687-8844 E-MAIL: RFP@THERMATRONENG.COM * Web Site: HTTP://WWW.THERMATRONENG.COM		
	APPROVED BY:	DATE: 11/02/2000	TITLE: HEAT EXCHANGER		
THIS DRAWING CONTAINS INFORMATION THAT IS RESTRICTED. USE OF THE INFORMATION CONTAINED HEREIN WITHOUT THE EXPRESS CONSENT OF THERMATRON ENGINEERING IS STRICTLY PROHIBITED.	MATERIAL: CU FIN, STAINLESS TUBE FINISH.	UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN INCHES.	CODE INDENT. No. 1GQ06	DRAWING No. 731TBM0	DRAWING SIZE: C
REFERENCE No. _____	TOLERANCE DECIMALS: .XX ± 0.020 .XXX ± 0.010 ANGLES: ± 1/2	THIRD ANGLE PROJECTION	SCALE: 1:1 SHEET: 1 OF 1		